

Safety Notes

⚠️ DANGER

BRANCH-CIRCUIT PROTECTION & SAFETY OVERLOAD PROTECTION

1. This product does not contain any branch-circuit protection or internal safety overload protection. The installer must add branch-circuit protection upstream of the unit, and provide external or remote safety overload protection to the end installation. Such branch-circuit and safety overload protection must comply with applicable local regulations. UL: The above mentioned branch-circuit protection is necessary for compliance with National Electric Code (NEC) requirements.

2. The cables used to connect the EPackLite's auxiliary supply and voltage reference must be correctly protected by branch-circuit protection. It is the responsibility of the installer to add branch-circuit protection. Such branch-circuit protection must comply with applicable local regulations.

HAZARD OF ELECTRICAL SHOCK, EXPLOSION OR ARC FLASH

3. Eurotherm shall not be held responsible for any damage, injury, losses or expenses caused by inappropriate use of the product (EPackLite), or failure to comply with these instructions.

4. If the product is used in a manner not specified by the manufacturer, the protection provided by the product might be impaired.

5. Disassembling the product is strictly forbidden.

6. The product must be installed and maintained by suitably qualified personnel, authorized to work in an industrial low voltage environment.

7. The product is not suitable for isolation applications, within the meaning of EN60947-1.

8. EPackLite alarms protect thyristors and loads against abnormal operation, and provide the user with valuable information regarding the type of fault. Under no circumstances must these alarms be regarded as a replacement for proper personnel protection. It is strongly recommended that the installing authority include independent, system-safety mechanisms to protect both personnel and equipment against injury or damage, and that such safety mechanisms be regularly inspected and maintained. Consult the EPackLite supplier for advice.

9. The product is designed to be installed in a cabinet connected to the protective earth ground according to IEC60364-1 and IEC60364-5-54 or applicable national standards.

10. Electrically conductive pollution must be excluded from the cabinet in which the product is mounted. To ensure a suitable atmosphere in conditions of conductive pollution, fit adequate air conditioning/filtering/cooling equipment to the air intake of the cabinet, e.g. fitting fan-cooled cabinets with a fan failure detection device or a thermal safety cut-out.

11. Before carrying out any wiring to the product, it must be ensured that all relevant power and control cables, leads or harnesses are isolated from voltage sources.

⚠️ DANGER

HAZARD OF ELECTRICAL SHOCK, EXPLOSION OR ARC FLASH

12. Before any other connection is made, the protective earth ground terminal shall be connected to a protective conductor. Wire conductor cross sections must comply with table 9 of IEC60947-1 or NEC Article 310 Table 310-16. U.L.: The earth connection must be made using a UL-listed ring type crimp. The cables used must be rated 90°C flexing copper only.

13. The protective earth ground connections and power terminals must be tightened according to the torque values defined in Table 1. Appropriate regular inspections must be performed.

14. Any interruption of the protective earth ground conductor inside or outside the product, or disconnection of the protective earth ground terminal is likely to make the product dangerous under some conditions. Intentional interruption is prohibited. Whenever it is likely that protection has been impaired, the unit shall be made inoperative, and secured against accidental operation. The manufacturer's nearest service centre must be contacted for advice.

15. Power connections: wire conductor cross sections must comply with table 9 of IEC60947-1 or NEC Article 310 Table 310-16. The cables used must be rated 90°C flexing copper only.

16. The 85Vac to 550Vac auxiliary supply shall be protected by a supplemental fuse or a dual protection fuse as defined in EPackLite Controller User Guide HA033172.

17. According to the CE and UL certifications, supplemental (high speed) fuses are mandatory for compliant installation and protection of the EPackLite Power Controller against short circuit, for further details see Fusing paragraph in the user Guide.

18. The EPackLite's rated short-circuit conditional current is 100kA for co-ordination type 2. Nevertheless, if opening of either the branch circuit protective or the supplemental (high speed) fuses occurs, the product shall be examined by suitably qualified personnel and replaced if damaged.

19. The maximum voltage between any pole of the power supply and terminals 1/L1, 3/L2 and Vref shall be lower than 550Vac. The maximum voltage between any pole of the power supply and earth ground shall be lower than 550Vac (rated insulation voltage 500V).

20. Connection of two conductors in the same terminal is not permitted.

Failure to follow these instructions will result in death or serious injury.

†SELV is defined (in IEC60947-1) as an electrical circuit in which the voltage cannot exceed 'ELV' under normal conditions or under single fault conditions, including earth ground faults in other circuits. The definition of ELV is complex as it depends on environment, signal frequency, etc. See IEC 61140 for further details.

The I/O connector (5-way) & auxiliary supply (24V ac/dc) (2-way) are compliant to the SELV requirements. The alarm relay output is compliant to the SELV requirements; it can be connected to SELV or to voltage up to 230V (Rated insulation voltage U_i : 230V)

⚠️ WARNING

- Signal and power voltage wiring must be kept separate from one another. Where this is impractical, shielded cables should be used for the signal wiring.
- Do not use the Vref terminal to replicate voltage signals (in a 'daisy chain'), as the PCB track between the two poles is not designed to withstand short-circuit.
- The product shall have one of the following as a disconnecting device, fitted within easy reach of the operator, and labelled as the disconnecting device:
 - A switch or circuit breaker which complies with the requirements of IEC60947-1 and IEC60947-3.
 - A separable coupler which can be disconnected without the use of a tool.
- The product is designed to be mounted vertically. There must be no obstructions (above or below) which could reduce or hamper airflow. If more than one instance of the product is located in the same cabinet, they must be mounted in such a way that air from one unit is not drawn into another.
- To reach the thermal performance the gap between two EPackLites must be at minimum 10mm.
- Under some circumstances, the EPackLite heatsink temperature may rise above 50°C and it can take up to 15 minutes to cool after the product is shut down. Give consideration to additional warnings and barriers to prevent injury.
- This product has been designed for environment A (Industrial). Use of this product in environment B (domestic, commercial and light industrial) may cause unwanted electromagnetic disturbances in which cases the installer may be required to take adequate mitigation measures.
- The 24V auxiliary supply must be derived from a SELV or PELV circuit†.
- To ensure that EPackLite complies with Electromagnetic Compatibility requirements, ensure that the panel or DIN rail to which it is attached is correctly grounded. The ground connection, designed to ensure ground continuity, is not in any way a substitute for the protective earth ground connection.
- IP20:** In order to maintain IP20 protection, the stripped length of the power cables from the supply and to the load must be adapted according to the insulation thickness.
- If the upper and/or lower access door is open and if voltage reference connector is removed, IP20 is compromised and the product is IP10.
- Breakaway features have been designed into the product especially to improve the IP20 rating. These features should be removed only for cable cross sections of 50mm² or more.
- To maintain maximum cooling efficiency, the Power Module heat-sink must be cleaned regularly. Periodicity depends on the local environment, but should not exceed six months
- Failure to follow these instructions can result in death, serious injury or equipment damage.**

EPack™ Lite

2Ph Power Controller

This sheet applies to EPackLite controllers providing control of two phases, for current ratings of 16A to 125A. It summarises important information.

⚠️ Do not attempt to install or operate the unit without reference to the EPackLite Controller User Guide HA033172

DVD Contents and Installation

This DVD contains Eurotherm Product Tools utility and configuration software, and includes a copy of the EPackLite Controller User Guide HA033172 in Adobe® PDF format. The DVD installer menu should autorun on Microsoft® Windows® computers.

Contact Information

Eurotherm Head Office

Faraday Close,

WORTHING

BN13 3PL

United Kingdom

Sales Enquiries

T +44 1903 695888

F +44 8451 309936

General Enquiries

T +44 1903 268500

F +44 845 265982

Worldwide Offices

www.eurotherm.com/worldwide

Scan for local contact



Eurotherm.
by Schneider Electric

© Copyright Eurotherm Limited 2017

Eurotherm by Schneider Electric, the Eurotherm logo, Chessell, EurothermSuite, Mini8, Eycorn, Eyriss, EPower, EPack, EpaLite nanodac, piccolo, versadac, optivis, Foxboro and Wonderware are trademarks of Schneider Electric, its subsidiaries and affiliates. All other brands may be trademarks of their respective owners.

All rights are strictly reserved. No part of this document may be reproduced, modified, or transmitted in any form by any means, nor may it be stored in a retrieval system other than for the purpose to act as an aid in operating the equipment to which the document relates, without the prior written permission of Eurotherm Limited.

Eurotherm Limited pursues a policy of continuous development and product improvement. The specifications in this document may therefore be changed without notice. The information in this document is given in good faith, but is intended for guidance only. Eurotherm Limited will accept no responsibility for any losses arising from errors in this document.

HA033169ENG_1

December 17

CN36125




Electrical Installation

⚠️ Connections are summarised below for quick reference—Do not attempt electrical installation without referring to the EPackLite Controller User Guide HA033172 for full details.


Supply and Load Wiring

A 125A EPackLite is shown below. Units for other current ratings are of similar appearance and are wired in the same manner. This diagram does not show the necessary external fuses that are required for branch circuit & safety overload protection.

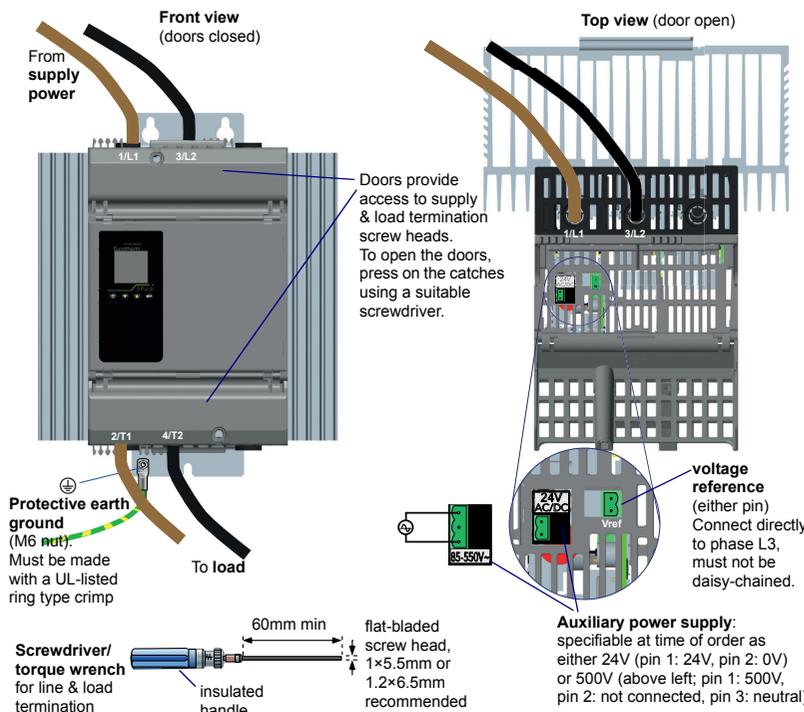

I/O Wiring

A 63A EPackLite is shown below. Units for other current ratings are of similar appearance and are wired in the same manner. Use a 0.6 × 3.5 mm screwdriver for pluggable connectors.

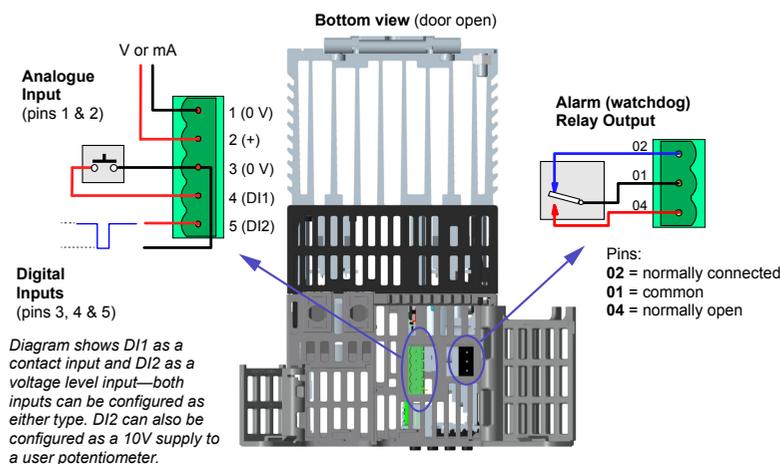

Analogue Input	Digital Inputs	Relay Output
Use the Adjust > Ana_in type menu to configure the input range as 0 to 10V, 1 to 5V, 2 to 10V, 0 to 5V, 0 to 20mA or 4 to 20mA. Selecting a mA range automatically places a suitable shunt resistor in the circuit, there is no need for the user to fit external components.	Absolute maxima for externally applied signals: ±30V or ±25mA Contact input ranges: open: 800Ω to ∞ undefined: 450Ω to 800Ω closed: 0Ω to 450Ω Source current 10mA min, 15mA max.	switching characteristics (resistive loads): $V_{max} = 264V$ RMS $V_{min} = 5V$ dc, $I_{max} = 2A$ RMS, $I_{min} = 10mA$.
	Voltage level input ranges: high: +11V to +30V (with current greater than 6mA) low: -3V to +5V (with current 2mA to 30mA), or +5V to +11V (with current of 2mA) User potentiometer supply (DI2 only): 10.2V±2%, 10mA; pot. range: 2kΩ to 10kΩ ±20%	

Terminal Capacity and Torques

Terminals	Terminal Capacity	Wire Type	Torque
1/L1 and 3/L2 (supply voltage) and 2/T1 and 4/T2 (load supply)	For 80A to 125A EPackLites: 10 mm ² to 50 mm ² (AWG 8 to AWG 2/0) For 16A to 63A EPackLites: 1.5 mm ² to 25 mm ² (AWG 16 to AWG 4)	Flexing copper rated 90°C	For 80A to 125A EPackLites: 5.6 N·m (50 lb-in) For 16A to 63A EPackLites: 2.0 N·m (18 lb-in)
⊥ (protective earth ground)	M6 ring-type crimp terminal. A UL-listed ring-type crimp terminal must be used.	Flexing copper rated 90°C	5.6 N·m (50 lb-in)
The following pluggable connectors are 5.08mm in pitch: Vref (2-way, voltage reference) 24V AC/DC (2-way, low voltage auxiliary supply) or 85V-550V- (3-way, high voltage auxiliary supply) 1 2 3 4 5 (5-way, I/O connector) 02 01 04 (3-way, alarm relay output)	0.25 mm ² to 2.5 mm ² (AWG 24 to AWG 12)	Flexing copper rated 75°C	0.56 N·m (5 lb-in)

Table 1 Supply Cable Sizes and Torques

Specification

This product is designed and produced to comply with:

Standard symbol	Standard details
	EN60947-4-3:2014. Low-voltage switchgear and controlgear - Part 4-3: Contactors and motor-starters - AC semiconductor controllers and contactors for non-motor loads (identical to IEC60947-4-3:2014). Declaration of conformity available on request.
	UL60947-4-1 CAN/CSA C22.2 No 60947-4-1-14 Low-Voltage Switchgear and Controlgear - Part 4-1: Contactors and Motor-Starters - Electromechanical Contactors and Motor-Starters up to 600V. U.L. File N° E86160.
	GOST IEC60947-4-3 : 2014 (identical to IEC60947-4-3:1999+AMD1:2006+AMD2:2011). EAC Declaration of conformity for the Customs Union EurAsEC. EAC approval and Pattern Approval (pending)
	Regulatory Compliance Mark (RCM) to Australian Communication and Media Authority. Based on compliance to EN60947-4-3:2014.

Installation Categories

	Installation Category	Rated impulse withstand voltage (U _{imp})	Rated Insulation Voltage
Communication	II	0.5kV	50V
Standard I/O	II	0.5kV	50V
Relays	III	4kV	230V
Module Power	III	6kV	500V

Table 2 Installation categories for EPackLite

Physical

Dimensions and mounting centres: See Mechanical Installation section for details

Weight:	16 to 32A units 40 to 63A units 80 to 100A units 125A units	2530g + user connectors 2970g + user connectors 5860g + user connectors 7940g + user connectors
---------	--	--

EMC

EMC immunity tests: EN60947-4-3:2014

EMC emission tests: EN60947-4-3:2014

This product has been designed for environment A (Industrial). Use of this product in environment B (domestic, commercial and light industrial) may cause unwanted electromagnetic disturbances in which case the user may need to take adequate mitigation measures

Power (at 45°C)

Voltage range	Load:	100 to 500V (+10% -15%)
	Auxiliary:	24V ac/dc (+20% -20%) or 100 to 500V (+10% -15%)

Frequency range: 47 to 63 Hz for load and ac auxiliary supplies)

Power requirement:	24V dc supply:	12W
	24V ac supply:	18VA
	500V ac supply:	20VA

Installation category: See Table 2

Nominal load current:	16A to 125A
Short circuit protection:	by external supplemental fuses (high speed fuse) see User Manual HA033172.
Rated short-circuit conditional current:	100kA (co-ordination type 2)
Pollution degree:	Pollution degree 2
Utilization categories (Load types):	AC51: Non-inductive or slightly inductive loads, resistance furnaces AC56a: Transformer primary
Duty cycle:	Uninterrupted duty / continuous operation
Load types:	Two-leg three phase control of resistive loads (low temperature coefficient and non-ageing/ageing types) and transformer primaries.
Overload conditions:	AC51: $1 \times I_n$ continuous (where I_n is the rated operational current, as per IEC 60947-4-3: 2014)

Operator Interface

Display: 1.44" square TFT colour display allowing viewing of selected parameter values in real time, plus configuration of instrument parameters for users with adequate access permission.

Push buttons: Four push buttons provide page and item entry and scroll facilities.

Environment

Temperature limits:	Operating:	0°C to 45°C at 1000m 0°C to 40°C at 2000m
	Storage:	-25°C to +70°C
Altitude:		1000m maximum at 45°C 2000m maximum at 40°C
Humidity limits:		5% to 95% RH (non-condensing)
Degree of Protection:	CE:	IP20 (EN60529)
Enclosure type ratings	UL:	Open Type
Atmosphere:		Non-explosive, non-corrosive, non-conductive
External wiring:	General:	Must comply with IEC60364-1 and IEC60364-5-54 and all applicable local regulations. Cross sections must comply with table 9 of IEC60947-1.
	UL:	Must comply with NEC and all applicable local regulations. Cross sections must comply with NEC, Article 310 Table 310-16.
Temperature rating:		Power conductors: 90°C; other wires: 75°C
Shock		According to EN60068-2-27 and IEC60947-1 (Annex Q, Category E)
Vibration (EN60068-2-6)		According to EN60068-2-6 and IEC60947-1 (Annex Q, Category E)

Symbols used in the instrument labelling

One or more of the symbols below may appear as part of the instrument labelling

	Protective conductor terminal		Risk of electric shock
	AC supply only		Precautions against static electrical discharge must be taken when handling this unit.
	Underwriters Laboratories listed mark for Canada and USA.		Refer to the manual for instructions.
	Do not touch heatsink hot surface.		Declaration of conformity to European standard.
	EAC (EurAsian Conformity) customs union mark of conformity		Regulatory compliance mark (RCM) to Australian Communication and Media Authority

China RoHS

The data shown here is related to the following version of China RoHS 2.0: Administrative Measures for the Restriction of Hazardous Substances in Electric Appliances and Electronic Products released December 7th 2017.

部件名称 Part Name	有害物质 Hazardous Substances					
	铅 (Pb)	汞 (Hg)	镉 (Cd)	六价铬 (Cr (VI))	多溴联苯 (PBB)	多溴二苯醚 (PBDE)
金属部件 Metal parts	0	0	0	0	0	0
塑料部件 Plastic parts	0	0	0	0	0	0
电子件 Electronic	X	0	0	0	0	0
触点 Contacts	0	0	0	0	0	0
线缆和线缆附件 Cables & cabling accessories	0	0	0	0	0	0

本表格依据SJ/T11364的规定编制。

O: 表示该有害物质在该部件所有均质材料中的含量均在GB/T 26572规定的限量要求以下

X: 表示该有害物质至少在该部件的某一均质材料中的含量超出GB/T 26572规定的限量要求。

This table is made according to SJ/T 11364.

O: indicates the concentration of hazardous substance in all of the homogeneous materials for this part is below the limit stipulated in GB/T 26572.
X: indicates concentration of hazardous substance in at least one of the homogeneous materials used for this part is above the limit stipulated in GB/T 26572

Signed (Kevin Shaw, R&D Director):

K. Shaw

Date:

7th December 2017


IA029470U745 Issue 5

December 2017

Mechanical Installation

Product dimensions are summarised below for quick reference—Do not attempt mechanical installation without referring to the EPackLite Controller User Guide HA033172 for full details

The diagram below shows a 63A EPackLite (doors open), other low current units are similar— refer to Table 3 for dimensions.

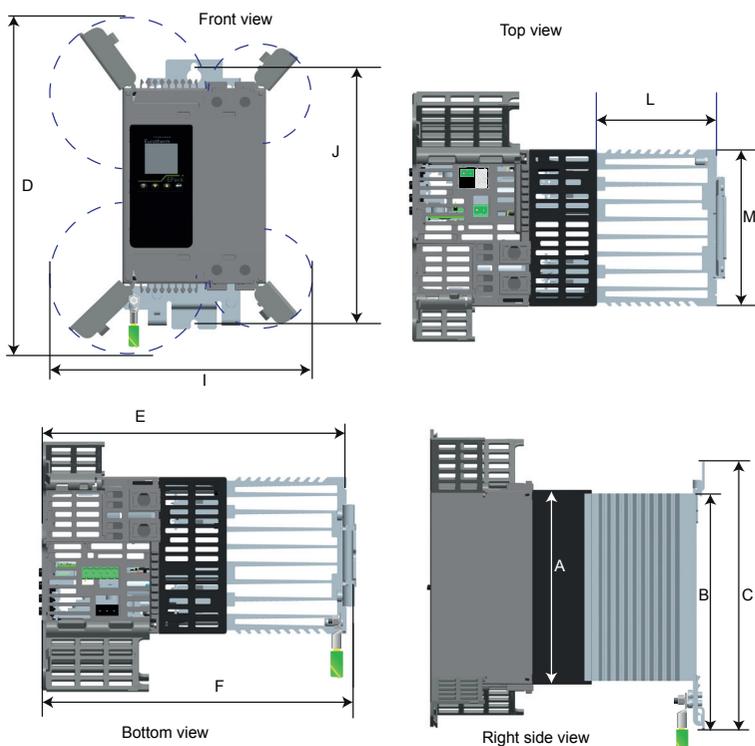

The diagram below shows a 125A EPackLite (doors open), 80 and 100A units are similar— refer to Table 3 for dimensions.

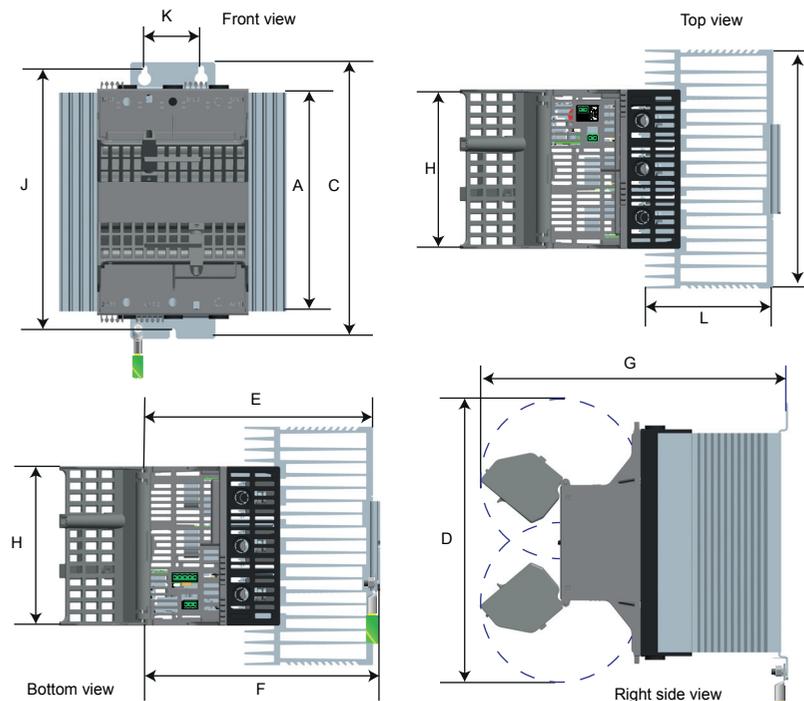


Table 3 Dimensions for EPackLites of different current ratings (all values in millimetres)

Label	Dimension	16–32A	40–63A	80–100A	125A
A	Height	166	166	230	230
B	with DIN Rail	213.5	213.5	not applicable	not applicable
C	with wallmount backplate	229.5	229.5	291	291
D	with doors open	290	290	310	310
E	Depth	185	220	235	235
F	with backplate	192	227	242	242
G	with doors open†	not applicable	not applicable	325	325
H	Width	117	117	160	240
I	with doors open†	242	242	not applicable	not applicable
J	Wall-mounting (top to bottom)	219	219	277	277
K	Wall-mounting (across top bracket)	not applicable	not applicable	60	60
L	Heatsink depth	not applicable	not applicable	not applicable	130
M	Heatsink width	117	117	160	240

† for low current EPackLites (16A to 63A) doors open to the side, increasing the effective width of the unit. For high current EPackLites (80A to 125A) doors open towards the front, increasing the effective depth of the unit. In both cases, opening the doors requires additional clearance above and below the unit.

Mounting

The EPackLite must be mounted inside a suitable fan-cooled cabinet as stipulated in the EPackLite Controller User Guide HA033172.

Within the cabinet, the following mounting options are possible (refer to HA033172 for detailed instructions):

- Low current units (16A to 63A) may be mounted on two horizontal, parallel 7.5mm or 15mm DIN rails, or wall-mounted on a bulkhead by fitting the supplied upper mounting bracket (which features a single mounting hole)
- High current units (80A, 100A and 125A) must be wall-mounted on a bulkhead. The upper mounting bracket features two mounting holes (see entry K in Table 3).